
A. E. C.

SP404/402 Data Line Protector Module


Mount the Protector Module

- 1, Ensure that the power to the panel and controller is isolated.
- 2, Present the module to the DIN rail and firmly press the module until the mounting clips "click" over the DIN rail. It may be necessary to open the mounting clip with a flat screwdriver.




Connect the Module to the Plant

3, Connect the SP404 as shown

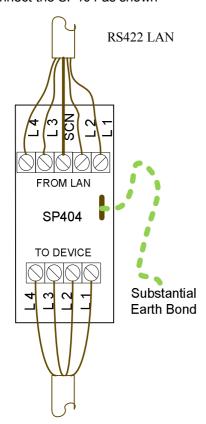

Connect the SP402 as shown

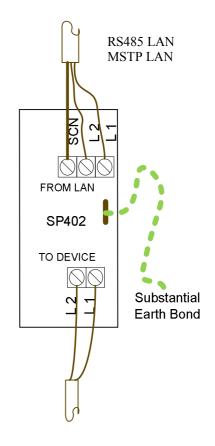

The level of protection is dependant on the module having a substantial earth bond to a true earth point. Keep the length of cable to the device to about 400 to 500mm.

Testing and Commissioning

4, Check the wiring, restore the power to the panel and commission the controller.

See also the SP404/402 Data Sheet for Specifications.